
















LEGEND

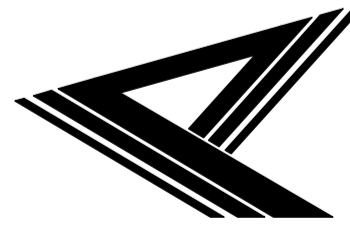
-  UNINSULATED DUCTWORK. DUCT SIZES ARE SHEET METAL SIZES.
-  G.S.S. DUCTWORK WITH 40mm THICK INTERNAL PERF FOIL FACED INSULATION. (R=1.2)
-  G.S.S. DUCTWORK WITH 40mm THICK EXTERNAL FOIL FACED INSULATION. (R=1.2)
-  G.S.S. DUCTWORK WITH 75mm THICK INTERNAL PERF FOIL FACED INSULATION. (R=2.0)
-  G.S.S. DUCTWORK WITH 75mm THICK EXTERNAL FOIL FACED INSULATION. (R=2.0)
-  G.S.S. DUCTWORK WITH 40mm THICK EXTERNAL FYRE WRAP & 40mm THICK INTERNAL PERF FOIL FACED INSULATION. (R=1.2)
-  G.S.S. DUCTWORK WITH 100mm THICK INTERNAL PERF FOIL FACED INSULATION. (R=3.0)
-  FLEXIBLE DUCTWORK WITH 38mm THICK EXTERNAL INSULATION AND VAPOUR BARRIER. (R=1.0) MAXIMUM DUCTWORK LENGTH: 3 METRES.
-  AIR DIFFUSION SYMBOL. REFER SCHEDULE.
-  HEIGHT OF DUCT ABOVE AFL.
-  DUCT NUMBER.
-  CONTROL STATION MOUNTED AT 1500 AFL.
-  TEMPERATURE SENSOR MOUNTED AT 1500 AFL. CW WITH 10M OF COIL LEFT ON TOP OF VAV. PUSH BUTTON MOUNTED AT 1500 AFL.
-  DRAINED TUNDISH BY OTHER TRADES.
-  600x600 ACCESS PANEL UNLESS NOTED OTHERWISE.

DUCT CONSTRUCTION NOTES.

1. ALL DUCTWORK SIZES ARE SHEETMETAL SIZES.
2. ALL RADIUS BENDS AND TRANSITIONS SHALL HAVE THE FOLLOWING MINIMUM STRAIGHTS:
BARE AND EXTERNAL INSULATION - 50mm.
50 INTERNAL INSULATION - 50mm.
75 INTERNAL INSULATION - 75mm.
100 INTERNAL INSULATION - 100mm.
3. ALL THROATS ON SQUARE BENDS SHALL BE 100 LONG UNLESS NOTED OTHERWISE.
4. DUCT ID LABELS ON TOP OF THE DUCT (NOT TO BE SEEN WHEN INSTALLED).
5. REFER TO REFLECTED CEILING PLAN FOR SET OUT LOCATIONS OF DIFFUSERS.
6. EXPOSED DUCTWORK TO BE HUNG WITH 'Z' BRACKET.
7. SPIRAL DUCTWORK SERVING C/H's TO BE 200mm LONGER TO ALLOW FOR ON SITE ADJUSTMENTS.

REV	DESCRIPTION	DATE	DRN	CHK
3	AS CONSTRUCTED	8.11.19	IW	PC
2	ISSUED FOR CONSTRUCTION	1.07.19	IW	PC
1	ISSUED FOR CONSTRUCTION	21.06.19	CO	PC
A	ISSUED FOR REVIEW	04.06.19	CO	PC

CONTRACTOR:



ENVAR
Engineers and Contractors Pty. Ltd.
ACN 009 407 630 ABN 35 009 407 630
47 Furnace Road
Welshpool W.A. 6106
Tel: (08) 9350 5377
Fax: (08) 9458 7484
envar@envargroup.com.au

TITLE:
**125 MURRAY STREET
125 MURRAY STREET, PERTH
LEVEL 7
DUCTWORK SECTIONS**

DATE: 8.11.19	SCALE: AS INDICATED @ A1	DRAWING NO: M-L7-300	REV: 3
DRAWN: CO	CHECKED: PC/NB		